


GENERAL NOTES

1. **UTILITY OWNERS:**
 NOTE TO DESIGNERS
 LIST ALL UTILITY OWNERS AFFECTED BY THIS PROJECT PER EXAMPLE BELOW:
 MRS. JEANNIE A. TALHOUK, FLORIDA POWER CORP: 4121 ST. LAWRENCE DRIVE,
 NEW PORT RICHEY, FL 34653 (813) 372-5102.
2. THE LOCATIONS OF EXISTING UTILITIES AS SHOWN ON THESE PLANS ARE APPROXIMATE AND BASED ON THE INFORMATION FURNISHED TO THE ENGINEER BY THE UTILITY OWNER(S) AND ARE SHOWN AS NOTICE TO THE CONTRACTOR THAT UNDERGROUND UTILITIES EXIST. BEFORE EXCAVATING, NOTIFY THE UTILITY COMPANY OWNER(S) AND REQUEST THEM TO LOCATE AND STAKE THEIR UNDERGROUND FACILITIES. UTILITIES ARE TO BE ADJUSTED BY OTHERS AS DIRECTED BY THE ENGINEER.
3. FOR ALTERNATIVE PROPOSED LUMINAIRES, SUBMITTAL DATA SHALL INCLUDE COMPUTER PRINTOUTS SHOWING POINT-TO-POINT HORIZONTAL FOOT-CANDLE LEVELS TO BE OBTAINED ON THIS PROJECT. LIGHTING DESIGN ANALYSIS REPORT SHALL BE USED, IF NO ALTERNATIVE LUMINAIRES ARE PROPOSED. AT FINAL INSPECTION, THE CONTRACTOR SHALL VERIFY THE HORIZONTAL FOOT-CANDLE LEVELS ON THE ROADWAY WITH AN APPROVED AND PROPERLY CALIBRATED LIGHT METER.
4. IN ACCORDANCE WITH N.E.C., IDENTIFY ALL CIRCUITS AND EQUIPMENT WITH "LAMACOID TAGS". INSTALL SIMILAR TAGS OF STAINLESS STEEL, IDENTIFYING CIRCUIT FOR EACH LUMINAIRE AT ACCESS HANDHOLE FOR EACH POLE.
5. NOTIFY UTILITY POWER SERVICE PROVIDER AT LEAST 48 HOURS PRIOR TO ANY INSTALLATION THAT IS WITHIN 10 FEET OF ENERGIZED ELECTRICAL CONDUCTORS. UTILITY POWER SERVICE PROVIDER, AT ITS OPTION, SHALL ASSIST THE F.D.O.T. CONTRACTOR TO COVER UP ENERGIZED CONDUCTORS AT INSTALLATION SITE OR TAKE OTHER SAFETY PRECAUTIONS AS NECESSARY. EXTREME CAUTION SHALL BE EXERCISED AT ALL TIMES IN PERFORMANCE OF WORK AROUND THE PRIMARY, HIGH VOLTAGE COMPONENTS.
6. PULLING INSTRUCTIONS: CONNECT PULLING DEVICES TO COPPER WIRE AND NOT TO JACKET AND MEET MANUFACTURER'S REQUIREMENTS. USE PULLING COMPOUND PER MANUFACTURER'S REQUIREMENTS. ALL BENDS SHALL NOT BE LESS THAN RECOMMENDED BY N.E.C. OR N.E.S.C. FOR CABLE USED. PULL CABLE SHALL BE POLYESTER. STEEL CABLE OR FISH TAPES NOT ALLOWED.
7. THE LIGHTING SYSTEM WILL BE MAINTAINED BY _____ UPON FINAL ACCEPTANCE.
8. EXISTING LIGHTING EQUIPMENT POWER SOURCES SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCING DEMOLITION/REMOVAL WORK.
9. ALL CONDUITS SHALL BE MANDREL TESTED AND CLEANED. CONDUITS PLACED FOR FUTURE USE SHALL HAVE 3/4" POLYESTER CORD PULLED IN PLACE AND CAPPED WITH NOTATION INSIDE CONDUIT AS TO LOCATION OF OPPOSITE END. PLACE DUCT MARKER OR PULL BOXES TO MARK ENDS OF EMPTY CONDUITS.
10. THE CONTRACTOR SHALL REMOVE ALL OUT OF SERVICE ROADWAY LIGHTING SYSTEM COMPONENTS INCLUDING UNDERGROUND AND SURFACE MOUNT CONDUITS, CONDUCTORS, POLE BASES, POLES, PULL BOXES, SERVICE POINTS, LOAD CENTERS, AND ALL OTHER ANCILLARY COMPONENTS RELATED TO THE LIGHTING SYSTEM NOTED IN THE PLANS.
11. ON REMOVED SIGN STRUCTURES, THE CONTRACTOR SHALL REMOVE ALL ASSOCIATED WIRING AND COMPONENTS FROM THE PULL BOX TO THE SIGN STRUCTURE, AND RE-SPLICE CONDUCTORS AS NEEDED.

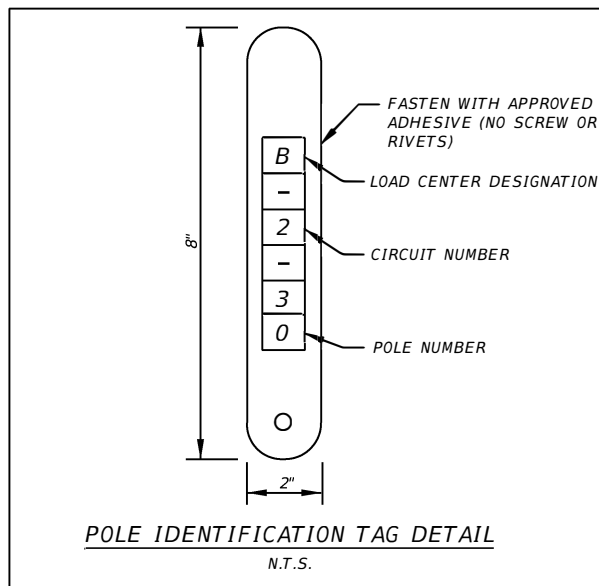

REVISIONS				STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION			GENERAL NOTE SHEET ROADWAY LIGHTING DESIGN
DATE	DESCRIPTION	DATE	DESCRIPTION	ROAD NO.	COUNTY	FINANCIAL PROJECT ID	
						- - -	